


ANNEXURE - 6

**TYPICAL CROSS SECTION OF
REINSTATEMENT FOR CABLE WORK**

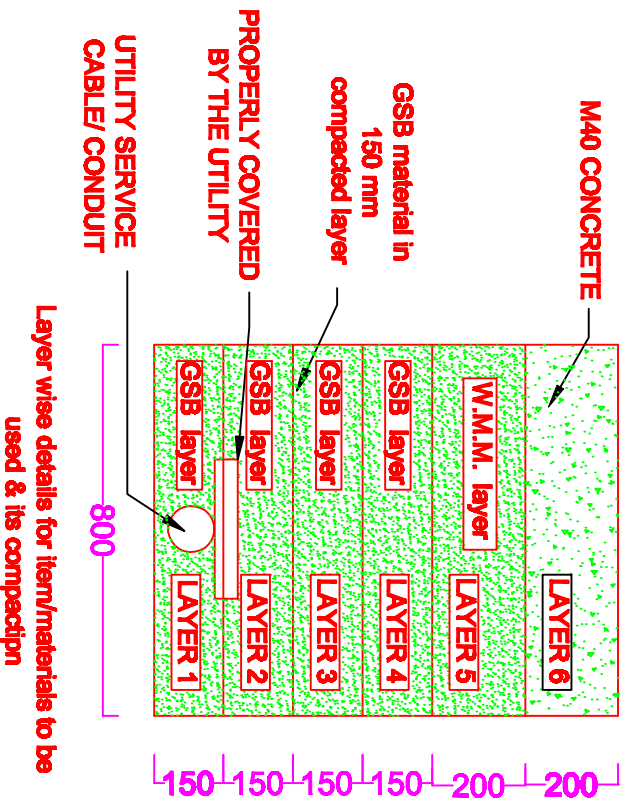

Layer No.	PMC Item DSR code no.	Description of Material	Remarks
Layer 1 & 2	Road part 2-8-1 88815	Granular Sub base Material	Sufficient watering & Ramming by Utility
Layer 3 & 4	Road part 2-8-1 88815	Granular Sub base Material	Sufficient watering & Ramming by Reinstatement contractor
Layer 5	Road part 2-10-1 88817	W.M.M. Material	Sufficient watering & Ramming by Reinstatement contractor
Layer 6 M40 CONCRETE	Road part 5-15-3 89147	M40 CONCRETE	-

NOTE : 1) The thickness and No. of Layers Granular Sub base Material filling will depend on proposed depth of excavation as per application from utility Annexure - 1

2) The maximum thickness of each Layer of Granular Sub base Material shall not be exceed 150 mm.